

Environmental Product Declaration

PB-System

According to EN 15804

Hot and cold water distribution on a cruise ship

Georg Fischer Piping Systems Ltd.
Ebnatstrasse 111
CH-8201 Schaffhausen
+41 (0) 52 631 11 11
www.gfps.com/sustainability
sustainability.ps@georgfischer.com

1. Declaration of general information

1.1 Introduction

GF Piping Systems is one of the three divisions within Georg Fischer Corporation and a leading provider of plastic and metal piping systems with global market presence. The product portfolio includes pipes, fittings, valves and the corresponding automation and jointing technology for industry, building technology as well as water and gas utilities. Georg Fischer Piping Systems proactively incorporates its environmental responsibility into its everyday business activities. Because we understand environmental awareness as one of the corporation's core values, internal structures and processes are geared towards sustainability. In this context, life cycle assessments are the correct tool to gain insight in the different life cycle phases of our systems.

This EPD is based on a detailed background report written by the Flemish Institute for technological research (Vito). The report is in line with EN 15804 "Sustainability of construction works – environmental product declarations – Core rules for the product category of construction products". The data of the study complies with the quality requirements set out in EN 15804 (EN 15804 +A1:2013, Sustainability of construction works - Environmental product declarations - Core rules for the product category of construction products). Data regarding the production of the pipe system components is company specific and was provided by GF Piping Systems.


Declaration

Declaration owner & Program operator's name	Georg Fischer Piping Systems Ltd.
Validity	01.06.2014 – 31.05.2019
Declaration Number	GFPS-EPD_1405-2_4
EPD-Type	Cradle to grave
Data calculated by	Vito NV (Flemish Institute for technological research) www.vito.be
Life Cycle Inventory (LCI) source for generic background processes	Ecoinvent v 2.2 (2010, updated August 2012)
Software	SimaPro 7.3.3



1.2 System

The analyzed case represents an exemplary system for the transport of fresh water to the cabins of a cruise ship. The installed piping system consists of the dimensions d110 (riser), d50 (decks) and d16 (cabins). The ship which has a length of 340 m comprises 18 decks with a length of 280 m and a total of 1 800 cabins. The system is installed in a dockyard in Turku (Finland). The used jointing technologies are socket welding and electrofusion.

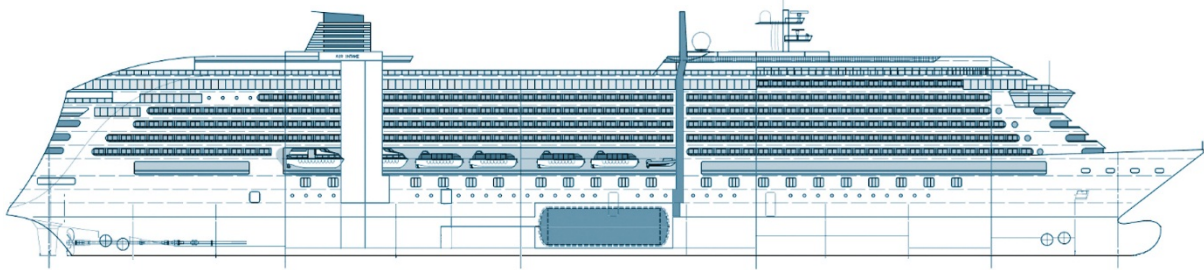

Materials

The material of the main pipe system components (pipes and fittings) is PB. The whole system consists of the materials as listed below

Material	Weight (kg)
PB	10 777
Brass	6 397
Plastics (other than PB)	403
Rubber	40
Steel	25
Paper	18
Printed wiring board	7
Other metals	6
Wire	5
Pump	
Iron	2 356
Bronze	398
Steel	217
Other metals	33
Rubber	8
Neoprene	2
Motor	
Steel	1 752
Other metals	976
Plastics	19
Insulation material	18
Chemicals organic, not specified	9
Paint	7

Reference service life time

20 years

Please refer to chapter 2.3 for further information on the reference service life time of the system.

Functional unit (FU)

The transport of hot and cold water in a PB piping system on a cruise ship via a riser (d110) and the decks (d50) to the taps of the toilet, shower and sink in the cabins (d16) over the whole lifetime of the system.

Components of the system (number of pieces or meter)


The system mainly consists of Georg Fischer Piping Systems components. However, to complete the system also external components (Ext.) which are not produced by Georg Fischer Piping Systems are necessary. The calculation of the environmental impact of these products is based on publicly available data and assumptions.

	Product Code	Pieces or meter	Material
System Components			
Cabin			
INSTAFLEX pipe, d16	760856606	32 400 m	PB
INSTAFLEX socket, d20	761066661	3 600	PB
INSTAFLEX electrofusion reducer d20/d16	761069277	3 600	PB (body) and others
INSTAFLEX elbow 90°, d16	760854842	7 200	Brass
INSTAFLEX brass tee 90°, equal, d16	760853125	7 200	Brass
INSTAFLEX single pipe outlet with flange, d16	760853013	10 800	Brass
Deck			
INSTAFLEX Pipe PB, d50	760856611	10 080 m	PB
INSTAFLEX weld-in-saddle, d50-d20	761068003	3 600	PB
INSTAFLEX electrofusion coupler, d50	761069205	1 728	PB (body) and others
Ball valve type 546, d20	760000343	3 600	PP-H (body) and others
Riser			
INSTAFLEX pipe, d110	760856615	180 m	PB
INSTAFLEX tee 90° equal, d110	761066629	72	PB
INSTAFLEX reducing bush, d110/d63	761066747	72	PB
INSTAFLEX reducing bush, d63/d50	761066690	72	PB
Pump connection			
INSTAFLEX Pipe PB, d110	760856615	10 m	PB
INSTAFLEX electrofusion coupler, d110	761069267	8	PB (body) and others
INSTAFLEX electrofusion elbow 90°, d110	761069223	1	PB (body) and others
INSTAFLEX flange adapter, d110	761069315	4	PB
INSTAFLEX backing flanges PN 16, d110	761065278	4	Iron
Butterfly valve type 567, d110	167567005	2	PP-H (body) and others
Motor	Ext.	6	Various metals and others
Pump	Ext.	6	Various metals and others

1.3 Comparability


EPDs of construction products may not be comparable if they do not comply with the EN 15804.

1.4 Demonstration of verification
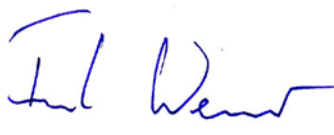
<p>CEN standard EN 15804 serves as core PCR.</p>	
<p>Independent verification of the declaration, according to EN ISO 14025:2010</p>	
<input type="checkbox"/> internal	<input checked="" type="checkbox"/> external
	
<hr style="width: 50%; margin: auto;"/> <p>Dr. Frank Werner</p>	
<p>Company: Dr. Frank Werner Umwelt & Entwicklung, Zürich (Switzerland)</p>	





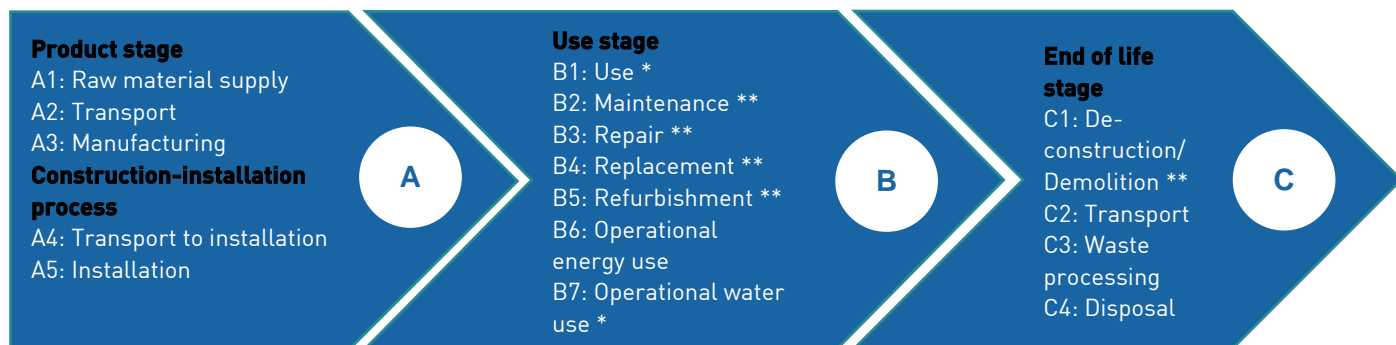


2. Declaration of environmental parameters derived from LCA

2.1 Flow diagram of the processes included in the LCA



* Stage not relevant, ** Environmental impact below cut-off criteria. Please refer to chapter 2.3 for details.

2.2 Parameters describing environmental impacts

Impact category		Global warming	Ozone depletion	Acidification of soil and water	Eutrophication	Photo-chemical ozone creation	Abiotic depletion - non fossil	Abiotic depletion - fossil
								
		kg CO ₂ eq	kg CFC-11 eq	kg SO ₂ eq	kg PO ₄ ³⁻ eq	kg C ₂ H ₄ eq	kg Sb eq	MJ
A1-3	Product stage	8.72E+04	7.30E-02	9.87E+02	4.23E+02	6.19E+01	1.31E+01	2.00E+06
A4	Transport to installation	4.01E+03	6.35E-04	2.66E+01	4.94E+00	7.85E-01	2.06E-02	5.95E+04
A5	Installation	2.83E+03	3.21E-04	8.42E+00	1.64E+00	2.38E+01	1.73E-02	3.65E+04
B1-5	Use, Maintenance, Repair, Replacement, Refurbishment	0	0	0	0	0	0	0
B6	Operational energy use	7.73E+05	9.20E-02	7.12E+03	4.18E+02	3.16E+02	1.18E-01	1.01E+07
B7	Operational water use	0	0	0	0	0	0	0
C1	De-construction/ Demolition	0	0	0	0	0	0	0
C2	Transport to end-of-life treatment	4.21E+03	6.41E-04	1.55E+01	2.97E+00	5.34E-01	3.41E-02	6.05E+04
C3	Waste processing	2.86E+04	1.67E-05	2.88E+00	6.43E-01	1.02E-01	3.77E-04	1.96E+03
C4	Disposal	0	0	0	0	0	0	0

2.3 Scenarios and additional technical information

The analyzed case represents an exemplary system for the transport of fresh water to the cabins of a cruise ship.

Product stage	
A1	The production of the plastic raw material was modeled via generic European data (source: ecoinvent) and complemented by specific data from GF Piping Systems to consider the company specific formulation of the raw material.
A2	Wherever possible, the specific transport distances were taken into account. Data from ecoinvent with the respective parameters was used to model the transportation.
A3	The use of energy is the most important input for this process step. Pipes are extruded while fittings and valve parts are injection moulded. Each of GF Piping Systems' worldwide production sites is certified according to ISO 14001 (Environmental management systems) and to OHSAS 18001 (Occupational health and safety management systems) or is currently in the certification process. For the production of GF Piping Systems components, electricity mixes for the respective country/continent were used. The production of external products was modeled using generic ecoinvent data records for the process.

Construction process

The system is installed in a dockyard in Turku (Finland). Transportation modes and distances to the installation site are as listed below. The following ecoinvent datasets were used: "Transport, lorry > 16 t, fleet average/RER U" (loading capacity 60%) and "Transport, transoceanic freight ship/OCE U".

The following components are first transported to storage.

A4	By truck	5 km	Flange adapters
		20 km	Sockets, electrofusion reducers, weld-in saddles, tees 90°, reducing bushes, electrofusion elbows 90°
		90 km	Pipes
		150 km	Valves
		459 km	Brass components (elbow 90°, tee 90°, single pipe outlet)
		808 km	Backing flanges
	By ship	19 960 km	Backing flanges

Afterwards the components are transported to the installation site by truck (1 029 km) and ship (1 135 km).

Distances and transportation modes for components transported directly to the installation site are as following

By truck	1 300 km	Pumps
	1 097 km	Motors
By ship	1 135 km	Motors

A5	For the installation of the whole system 580 kWh welding energy (ecoinvent dataset: Electricity, low voltage, production FI, at grid/FI U) is needed. Furthermore, specific cleaner (59 kg/FU) for the jointing is necessary. The cleaner is transported by truck and ship over a distance of 2 704 km. Outputs of the complete installation of the system are PB pipe cut-off (17 kg/FU) and packaging waste (7 086 kg/FU) whereof 78% is cardboard. Wood and cardboard is recycled. PB pipe cut-off and PE-film are incinerated. Transport distance to recycling is assumed to be 600 km, transport to incineration 150 km. Transport is carried out by truck.
----	--

Use stage	
B1	There are no further environmental impacts arising from the use of the system. This stage is considered as not relevant.
B2-B5	<p>The system is designed to be operated without repair, maintenance, replacement or refurbishment during the reference service life time. This is subject to the condition that the system is operated according to the specifications given by GF Piping Systems.</p> <p>The lifetime of a valve is mainly influenced by the actuation cycles. The number of actuation cycles the valves are tested for is not reached during the life time of the evaluated system. It is possible that in individual cases components of the valve (e.g. seals) must be replaced. In this case the environmental impact is negligible compared to the impact of the whole system and below the cut-off criteria defined in EN 15804.</p>
B6	The operational use of the system is an important stage because of the long reference service life time of 20 years. 873 500 kWh of energy (ecoinvent dataset: Electricity, oil, at power plant/UCTE U) during the use stage is necessary per functional unit.
B7	No operational water use is necessary for the system. This stage is considered as not relevant.
End of life stage	
C1	De-construction of the system is mainly manual work. A small energy input is needed to cut the pipes. The environmental impact is negligible compared to the impact of the whole system and below the cut-off criteria defined in EN 15804.
C2	Transportation to the end of life treatment facilities is carried out by truck. Distances are 600 km for recycling and 150 km for incineration.
C3	It is assumed that all metal parts are recycled and all other parts are incinerated with energy recovery. The exported energy is in the form of electricity and thermal energy. Approximately 11.5% of the net energy content of the incinerated waste is converted to electricity and 23.4% is converted to heat. Both are sold to external consumers. These values reflect the situation in Swiss municipal waste incinerators about 10 years ago, as reported in ecoinvent documentation.
C4	It is assumed that all metal parts are recycled and all other parts are incinerated with energy recovery. Therefore module C4 is not relevant.

Reference service life data

Parameter	Data																																							
Reference Service Life	20 years																																							
Declared product properties	System components are compliant with relevant international approvals and standards e.g. <ul style="list-style-type: none"> • EN (European Standards) • ISO (International Organization for Standardization) • BS (British Standard) 																																							
	Most relevant standards are: ISO 15494 Plastics piping systems for industrial applications - Polybutene (PB), Polyethylene (PE) and Polypropylene (PP) - Specifications for components and the system ISO 15876 Plastics piping systems for hot and cold water installations - Polybutene (PB)																																							
	Approvals for INSTAFLEX in Shipbuilding:																																							
	<table border="1"> <thead> <tr> <th>Country / Organization</th> <th>Institute</th> </tr> </thead> <tbody> <tr> <td>Bureau Veritas</td> <td>CCS</td> </tr> <tr> <td>German Lloyds</td> <td>GL</td> </tr> <tr> <td>Italy</td> <td>RINA</td> </tr> <tr> <td>Lloyd's Register</td> <td>LR</td> </tr> <tr> <td>Norway</td> <td>DNV</td> </tr> <tr> <td>Russia</td> <td>RMROS</td> </tr> <tr> <td>USA</td> <td>ABS</td> </tr> </tbody> </table>	Country / Organization	Institute	Bureau Veritas	CCS	German Lloyds	GL	Italy	RINA	Lloyd's Register	LR	Norway	DNV	Russia	RMROS	USA	ABS																							
Country / Organization	Institute																																							
Bureau Veritas	CCS																																							
German Lloyds	GL																																							
Italy	RINA																																							
Lloyd's Register	LR																																							
Norway	DNV																																							
Russia	RMROS																																							
USA	ABS																																							
Design application parameters	<table border="1"> <thead> <tr> <th>PB characteristics</th> <th>Value</th> <th>Test standard</th> </tr> </thead> <tbody> <tr> <td>Operating temperature range</td> <td>0 °C to + 95 °C</td> <td></td> </tr> <tr> <td>Density</td> <td>0.94 g/cm³</td> <td>EN ISO 1183</td> </tr> <tr> <td>Melt flow index 190/2.16</td> <td>0.4 g/10 min</td> <td>EN ISO 1133</td> </tr> <tr> <td>Yield stress at 23 °C</td> <td>20 MPa</td> <td>EN ISO 527-1</td> </tr> <tr> <td>Elongation at break at 23°C</td> <td>300%</td> <td>EN ISO 527-1</td> </tr> <tr> <td>Flexural modulus of elasticity at 23 °C</td> <td>450 MPa</td> <td>ISO 178</td> </tr> <tr> <td>Notched impact test at 23 °C</td> <td>37 kJ/m²</td> <td>EN ISO 179 - 1/1eA</td> </tr> <tr> <td>Notched impact test at 0 °C</td> <td>20 kJ/m²</td> <td>EN ISO 179 - 1/1eA</td> </tr> <tr> <td>Ball indentation hardness (132 N)</td> <td>43 MPa</td> <td>EN ISO 2039 - 1</td> </tr> <tr> <td>Coefficient of thermal expansion</td> <td>0.13 mm/m K</td> <td>ASTM D696</td> </tr> <tr> <td>Thermal conductivity at 23 °C</td> <td>0.19 W/m K</td> <td>ASTM E1530</td> </tr> <tr> <td>Moisture absorption at 23 °C</td> <td>0.01-0.04%</td> <td>EN ISO 62</td> </tr> </tbody> </table>	PB characteristics	Value	Test standard	Operating temperature range	0 °C to + 95 °C		Density	0.94 g/cm ³	EN ISO 1183	Melt flow index 190/2.16	0.4 g/10 min	EN ISO 1133	Yield stress at 23 °C	20 MPa	EN ISO 527-1	Elongation at break at 23°C	300%	EN ISO 527-1	Flexural modulus of elasticity at 23 °C	450 MPa	ISO 178	Notched impact test at 23 °C	37 kJ/m ²	EN ISO 179 - 1/1eA	Notched impact test at 0 °C	20 kJ/m ²	EN ISO 179 - 1/1eA	Ball indentation hardness (132 N)	43 MPa	EN ISO 2039 - 1	Coefficient of thermal expansion	0.13 mm/m K	ASTM D696	Thermal conductivity at 23 °C	0.19 W/m K	ASTM E1530	Moisture absorption at 23 °C	0.01-0.04%	EN ISO 62
	PB characteristics	Value	Test standard																																					
	Operating temperature range	0 °C to + 95 °C																																						
	Density	0.94 g/cm ³	EN ISO 1183																																					
	Melt flow index 190/2.16	0.4 g/10 min	EN ISO 1133																																					
	Yield stress at 23 °C	20 MPa	EN ISO 527-1																																					
	Elongation at break at 23°C	300%	EN ISO 527-1																																					
	Flexural modulus of elasticity at 23 °C	450 MPa	ISO 178																																					
	Notched impact test at 23 °C	37 kJ/m ²	EN ISO 179 - 1/1eA																																					
	Notched impact test at 0 °C	20 kJ/m ²	EN ISO 179 - 1/1eA																																					
	Ball indentation hardness (132 N)	43 MPa	EN ISO 2039 - 1																																					
	Coefficient of thermal expansion	0.13 mm/m K	ASTM D696																																					
	Thermal conductivity at 23 °C	0.19 W/m K	ASTM E1530																																					
Moisture absorption at 23 °C	0.01-0.04%	EN ISO 62																																						
For more information, please refer to the planning fundamentals which are available at: gfps.com > support & services > Planning Assistance > Planning Fundamentals > Building Technology																																								
Assumed quality of work	<ul style="list-style-type: none"> • Constant water supply without interrupting operations • Leakproof systems reduce water losses • Flexibility of plastics pipes minimizes the risk of water hammer • No corrosion and no incrustation reduces maintenance to a minimum • Low thermal conductivity results in minimum heat loss • Low noise transmission 																																							
Usage conditions	<ul style="list-style-type: none"> • SDR 11 • PN 16 • Flow rate 1.5 m/s (average), 5.5 m/s (maximum) 																																							
Maintenance	The system is designed to be operated without repair, maintenance, replacement or refurbishment. This is subject to the condition that the system is installed and operated according to the specifications given by GF Piping Systems. Please refer also to Chapter 2.3.																																							

2.4 Parameters describing resource use

Parameters describing resource use, primary energy		Product stage	Construction process stage		Use stage			End of life			
		Total (of product stage)	Transport	Construction installation process	Use, Maintenance, Repair, Replacement, Refurbishment	Operational energy use	Operational water use	De-construction / Demolition	Transport	Waste processing	Disposal
		A1-3	A4	A5	B1-B5	B6	B7	C1	C2	C3	C4
Use of renewable primary energy excluding renewable primary energy resources used as raw materials		7.71E+04	8.34E+02	2.61E+03	0	2.57E+04	0	0	1.38E+03	5.38E+01	0
Use of renewable primary energy resources used as raw materials		1.68E+01	0	0	0	0	0	0	0	0	0
Total use of renewable primary energy resources (primary energy and primary energy resources used as raw materials)		7.71E+04	8.34E+02	2.61E+03	0	2.57E+04	0	0	1.38E+03	5.38E+01	0
Use of non-renewable primary energy excluding non-renewable primary energy resources used as raw materials		1.70E+06	6.33E+04	4.13E+04	0	1.02E+07	0	0	6.70E+04	2.21E+03	0
Use of non-renewable primary energy resources used as raw materials		4.74E+05	0	7.09E+02	0	0	0	0	0	0	0
Total use of non-renewable primary energy resources (primary energy and primary energy resources used as raw materials)		2.18E+06	6.33E+04	4.20E+04	0	1.02E+07	0	0	6.70E+04	2.21E+03	0
	MJ, net calorific value										

Parameters describing resource use, secondary materials and fuels, and use of water		Product stage	Construction process stage		Use stage			End of life			
		Total (of product stage)	Transport	Construction installation process	Use, Maintenance, Repair, Replacement, Refurbishment	Operational energy use	Operational water use	De-construction / Demolition	Transport	Waste processing	Disposal
		A1-3	A4	A5	B1- B5	B6	B7	C1	C2	C3	C4
Use of secondary material*	kg	0	0	0	0	0	0	0	0	0	0
Use of renewable secondary fuels*	MJ, net calorific value	0	0	0	0	0	0	0	0	0	0
Use of non-renewable secondary fuels*	MJ, net calorific value	0	0	0	0	0	0	0	0	0	0
Net use of fresh water	m ³	1.08E+03	1.57E+01	1.11E+01	0	1.40E+03	0	0	1.73E+01	1.26E+01	0

*Only for foreground process from which LCI data are made available by GF Piping Systems - the number does not include processes and materials modelled by means of background data, e.g. transportation, electricity, ancillary materials, etc.

2.5 Environmental information describing output flows

Other environmental information describing output flows		Product stage	Construction process stage			Use stage			End of life		
		Total (of product stage)	Transport	Construction installation process	Use, Maintenance, Repair, Replacement, Refurbishment	Operational energy use	Operational water use	De-construction / Demolition	Transport	Waste processing	Disposal
		A1-3	A4	A5	B1-B5	B6	B7	C1	C2	C3	C4
Components for re-use*	kg	0	0	0	0	0	0	0	0	0	0
Materials for recycling*	kg	9.07E+01	0	6.96E+03	0	0	0	0	0	1.22E+04	0
Materials for energy recovery*	kg	0	0	0	0	0	0	0	0	0	0
Exported energy - electricity*	MJ per energy carrier	7.07E+01	0	7.32E+02	0	0	0	0	0	1.58E+05	0
Exported energy - thermal energy*	MJ per energy carrier	1.50E+02	0	1.47E+03	0	0	0	0	0	3.16E+05	0

*Only for foreground process from which LCI data are made available by GF Piping Systems - the number does not include processes and materials modelled by means of background data, e.g. transportation, electricity, ancillary materials, etc.

Other environmental information describing waste categories		Product stage	Construction process stage			Use stage			End of life		
		Total (of product stage)	Transport	Construction installation process	Use, Maintenance, Repair, Replacement, Refurbishment	Operational energy use	Operational water use	De-construction / Demolition	Transport	Waste processing	Disposal
		A1-3	A4	A5	B1-B5	B6	B7	C1	C2	C3	C4
Hazardous waste disposed	kg	1.90E+00	6.67E-02	4.45E-02	0	3.99E+00	0	0	7.73E-02	1.04E-02	0
Non-hazardous waste disposed		1.36E+04	4.29E+02	1.88E+02	0	3.54E+03	0	0	3.57E+02	3.63E+02	0
Radioactive waste disposed		2.02E+00	5.18E-02	7.32E-02	0	2.11E+00	0	0	8.73E-02	3.45E-03	0

Your contact

Georg Fischer Piping Systems Ltd.
Ebnatstrasse 111
CH-8201 Schaffhausen
Switzerland

Phone +41 (0) 52 631 11 11
www.gfps.com/sustainability
sustainability.ps@georgfischer.com

